




# CAST BRASS GRID DRAIN



## PLUMBING PRODUCT SPECIFICATION

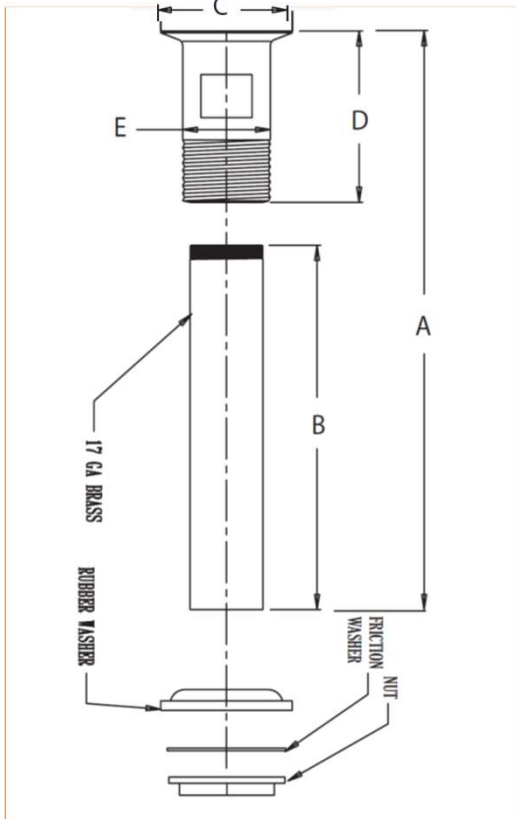

INSTALLATION MEASUREMENTS					
PART NO	A	B	C	D	E
5680CTK	8 13/16	6	2 1/4	2 1/2	1 1/2
5680CTNOK	8 13/16	6	2 1/4	2 1/2	1 1/2

### PART # SUFFIX DESIGNATIONS

- CT - Concave Top
- NO - No overflow opening
- K - Keeney

### DESCRIPTION

Cast brass chrome plated high performance grid drain w/ 1 1/4" 17 ga seamless brass threaded one end tailpiece

### INCLUDES:

- 14 gallon per minute flow rate drain
- Thermoplastic (TPE) elastomer basin washer
- Heavy brass locknut with large wrench flats
- Red fiber friction washer
- Puttyless rim gasket
- Heavy duty chrome finish

### INDUSTRY APPROVALS

- cUPC/IAPMO

Listing of parts approved for specific codes available

#### SPECIFIER APPROVAL

Job Name \_\_\_\_\_ Date \_\_\_\_\_  
 Model \_\_\_\_\_ Qty \_\_\_\_\_  
 Wholesaler \_\_\_\_\_  
 Contractor \_\_\_\_\_  
 Architect \_\_\_\_\_

**FOR MORE INFORMATION CALL 1-800-243-0526  
 OR E-MAIL NCS@UPT.COM**

THE KEENEY MANUFACTURING COMPANY

[www.keeneymfg.com](http://www.keeneymfg.com)

*Keeney Representative  
 Stamp or Label Here*

**TEST REPORT**

**Evaluation of Lavatory Grid Drain**

By

*Shugeng Qian*

*March 4, 2019*

*Prepared for*

**Keeney Manufacturing Co.  
1170 Main Street  
Newington, CT 06111**

**Report No. KEM020119R**

*Prepared by*

**Center for Environmental Systems  
Stevens Institute of Technology  
Hoboken, NJ 07030  
Tel: 201 216 5697 Fax: 201 216 8303**



**TEST CRITERIA**

All tests and evaluations were made in accordance with Section 5.8.1 of ASME A112.18.2-2015 – Plumbing waste fittings

**RESULTS**

The testing procedure was according to Section 5.8.1 of ASME A112.18.2-2015. The sample to be tested was installed to a container with an opening at the bottom. A sustained water head of 6.0 inches was applied above the inlet and the outlet of the sample was open to the atmosphere. The flowrate out of drainage was recorded. The test results are listed in Table 1

**Table 1: Flowrate out of drainage**

Sample Description	Flow Rate, gpm				
	1st trail	2nd trail	3 <sup>rd</sup> trail	Average	RSD, %
<b>Lavatory Grid drain with overflow opening</b>					
Keeney New	14.8	14.6	14.5	14.6	1.04
Keeney 5681PCCR	8.8	8.7	8.8	8.8	0.66
Leading Competitors	9.6	9.5	9.7	9.6	1.04
<b>Lavatory Grid drain less overflow opening</b>					
Keeney New	14.9	14.9	14.9	14.9	0.00
Leading Competitors	12.9	12.6	12.7	12.7	1.20